



RatioMatic

Burners

Model RM700 Version 3.00

Specfications

PARAMETER		SPECIFICATIONS				
Maximum input (Btu/hr)	Frequency	BTU/hr	"w.c.	kW	mbar	
Note: Contact factory for varying chamber pressures or pressures outside the range: -5.0" to 5.0" w.c. (-12,4 to 12,4 mbar)	60 Hz	7,640,000	-5.0	2240	-12,4	
	Packaged	7,260,000	-2.0	2130	-5,0	
	Blower	7,000,000	0.0	2050	0,0	
		6,720,000	2.0	1970	5,0	
		6,290,000	5.0	1840	12,4	
Minimum input		BTU/hr		kW		
			80,000	23		
Main Gas Inlet Pressure		psig mbar				
• Fuel pressure at ratio regulator inlet	Natural gas		1.5 to 2.5 105 to 175		5	
	Propane	1.5 to 2.0 105 to 140)		
High Fire Flame Length			inches	mm		
Measured from the outlet end of combustor	Natural gas		75	1900		
	Propane	88		2200		
Maximum Chamber Temperature			F		<u></u>	
	Alloy Tube	1500		820		
	Block & holder		1900	1040		
Flame Detection	Alloy Tube	Flame rod or UV scanner				
	Block & holder	UV scanner only				
Fuel	Natural gas or Propane.					
		For any other gas, contact Eclipse Combustion for orifice sizing				

• All information is based on laboratory testing. Different chamber size and conditions will affect the data.


• Maximum inputs are given for the standard combustion air blower without an air filter.


• All inputs based upon gross calorific values and standard conditions; I atmosphere, 70° F (21°C).

 Eclipse reserves the right to change the construction and/or configuration of our products at any time without being obliged to adjust earlier supplies accordingly.



Performance Graphs RatioMatic RM700

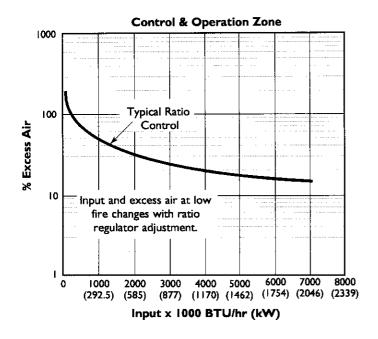

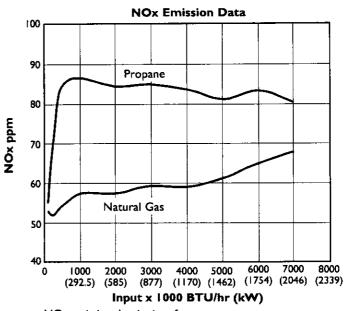


NOx emission data is given for:

- Ambient combustion air ~70° F (20° C)
- Less than 1000° F (540° C) firing chamber
- Minimal process air velocity
- Low fire input adjusted to 80,000 BTU/hr (23kW)
- ppm volume, dry @ 3% O₂
- Neutral chamber pressure


Emissions are influenced by:

- Chamber conditions
- Fuel type
- Firing rate
- Ratio regulator adjustment
- Combustion air temperature

CO emission is largely influenced by chamber conditions. Contact your local Eclipse Combustion representative for an estimate of CO emission on your application

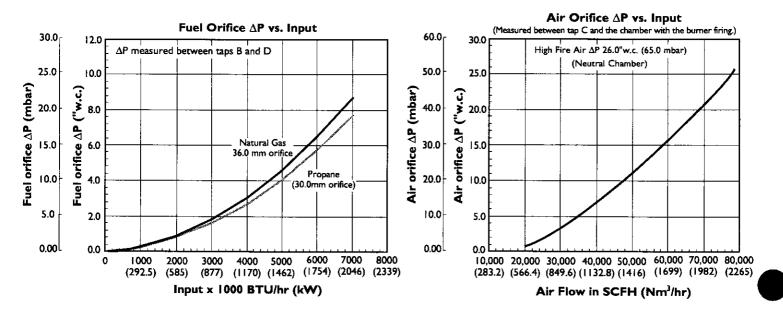

Eclipse Model RM700, v3.00, Data 110-16, 6/00

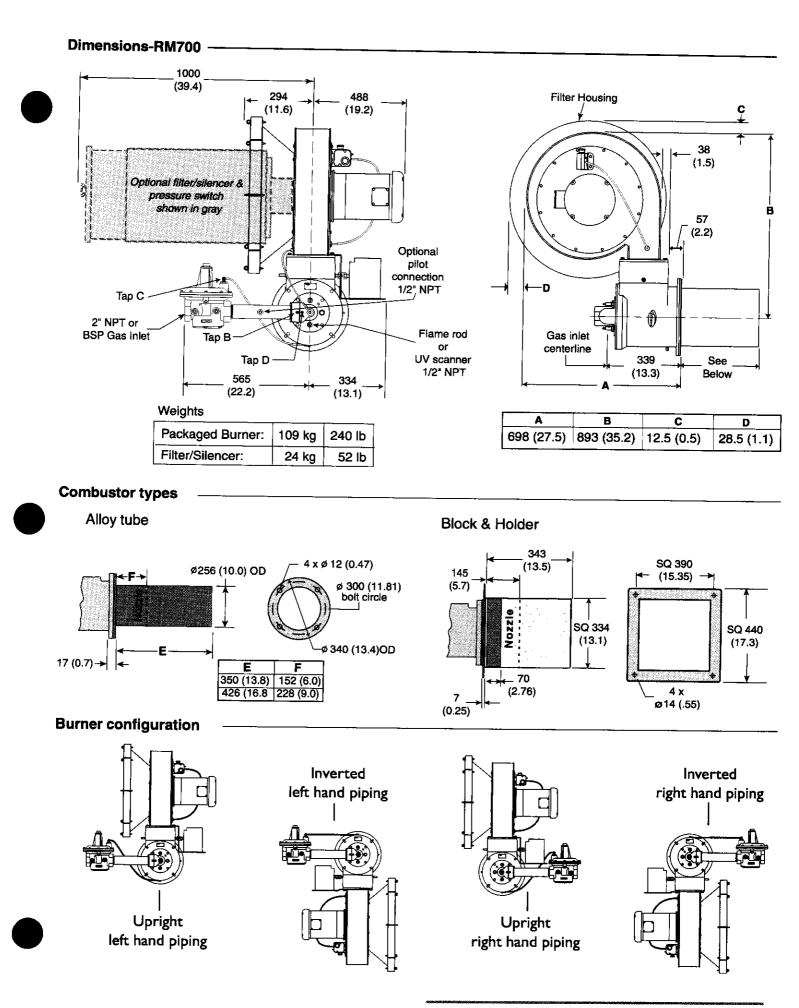



Offered By: Power Equipment Company 2011 Williamsburg Road Richmond, Virginia 23231 Phone (804) 236-3800 Fax (804) 236-3882

www.peconet.com