

**NOTE:**

INSTALLATION, OPERATION AND MAINTENANCE SHALL CONFORM WITH NATIONAL FIRE PROTECTION ASSOCIATION STANDARDS, NATIONAL AND LOCAL CODES AND AUTHORITIES HAVING JURISDICTION

**NOTES:**


WIRING AND INSTALLATION TO CONFORM WITH NATIONAL AND LOCAL ELECTRICAL CODES. ALL WIRING AND EQUIPMENT EXTERNAL TO PROTECTAL CONTROL PANEL TO BE FURNISHED BY OTHERS UNLESS OTHERWISE SPECIFIED.

**NOTE:**

IGNITION CABLE MUST BE RUN IN SEPARATE CONDUIT TO SPARK ELECTRODE. (DO NOT MIX WITH 115V. WIRING.)

**NOTES:**

FLAME WIRE TO BE NO. 14 TYPE TW. 600V. INSULATED WIRE OR EQUAL. FLAME WIRE MUST NOT BE IN SAME CONDUITS WITH POWER WIRING.

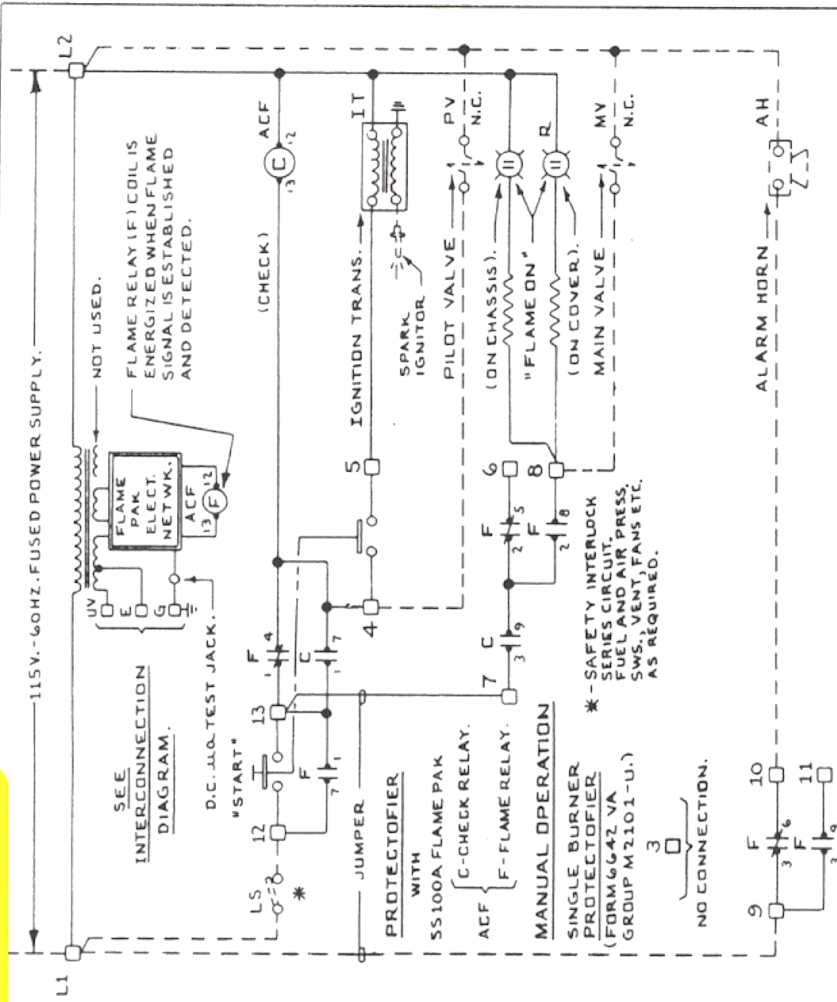

**CIRCUIT DIAGRAM**

□ INTERNAL WIRING.  
 --- EXTERNAL WIRING.

REVISED AND REDRAWN.

PROTECTION CONTROLS, INC.	
SKOKIE, ILLINOIS	
WIRING DIAGRAM FOR:	
PROTECTAL NO. 62019-1VA	
JOB NO.	DRWN. BY DATE
	H.R.V. 6-8-79
	DRAWING NO. X-256