


POWER EQUIPMENT CO.

Manufacturers Representative

2011 Williamsburg Rd. • Richmond, VA 23231

(804) 236-3800 • FAX (804) 236-3882

www.peconet.com

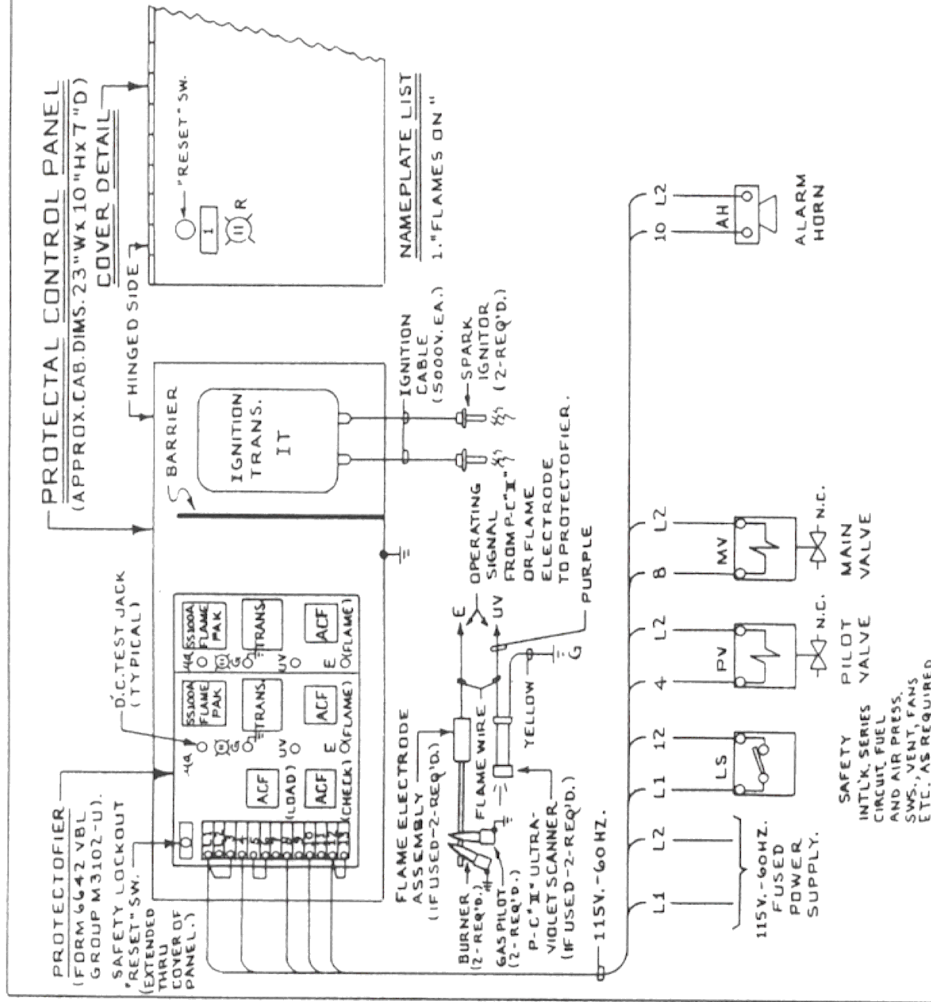


INTERCONNECTION DIAGRAM

NOTE:
INSTALLATION, OPERATION AND MAINTENANCE SHALL CONFORM WITH NATIONAL FIRE PROTECTION ASSOCIATION STANDARDS, NATIONAL AND LOCAL CODES AND AUTHORITIES HAVING JURISDICTION.

NOTES:
WIRING AND INSTALLATION TO CONFORM WITH NATIONAL AND LOCAL ELECTRICAL CODES, ALL WIRING AND EQUIPMENT EXTERNAL TO PROTECTAL CONTROL PANEL TO BE FURNISHED BY OTHERS UNLESS OTHERWISE SPECIFIED.

NOTE:
IGNITION CABLE MUST BE RUN IN SEPARATE CONDUIT TO SPARK ELECTRODE. (DO NOT MIX WITH 115V. WIRING.)

NOTES:
FLAME WIRE TO BE NO. 14 TYPE TW, 600V, INSULATED WIRE OR EQUAL. FLAME WIRE MUST NOT BE IN SAME CONDUITS WITH POWER WIRING.

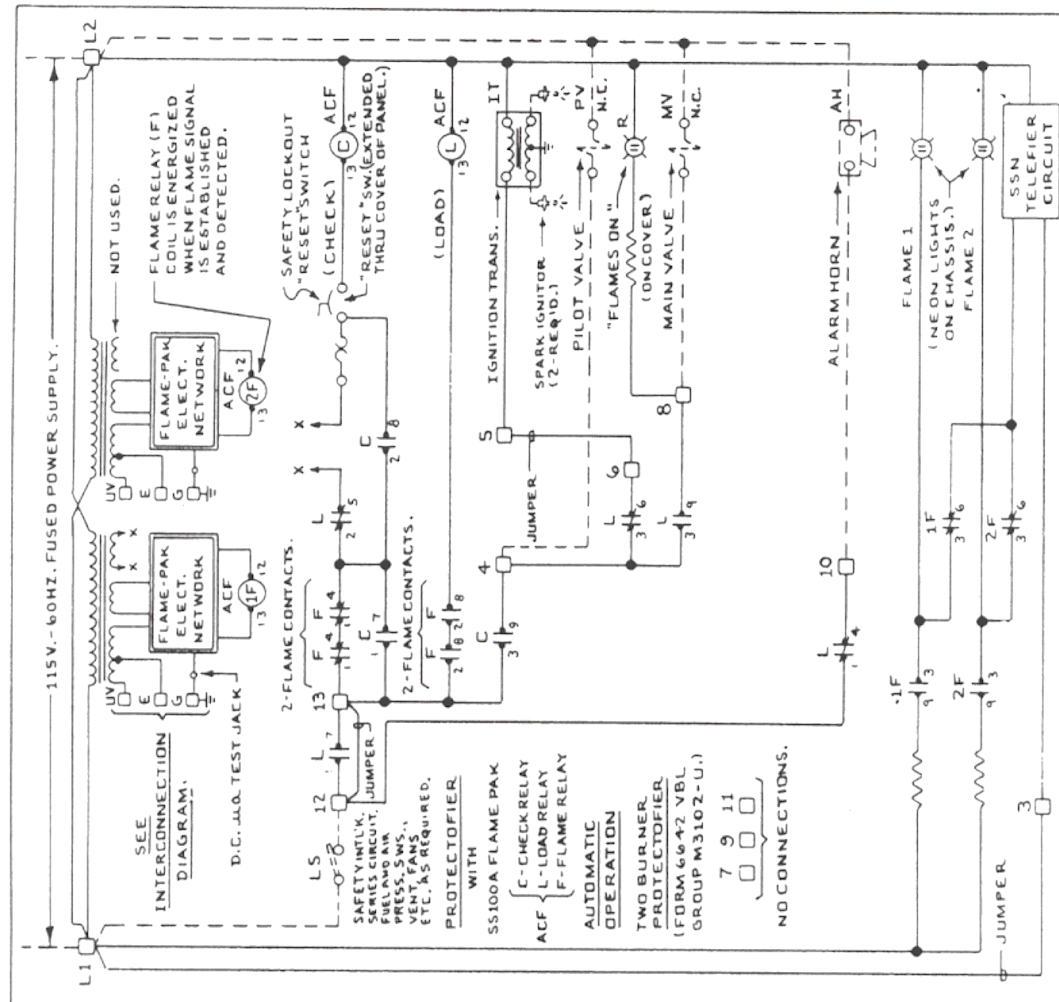

CIRCUIT DIAGRAM

— INTERNAL WIRING.
- - - EXTERNAL WIRING.

PROTECTION CONTROLS, INC.	
SKOKIE, ILLINOIS	
WIRING DIAGRAM FOR:	
PROTECTAL NO. 62019-2VBL	
JOB NO.	DATE
TR	1-16-77
DRWN BY	X-260